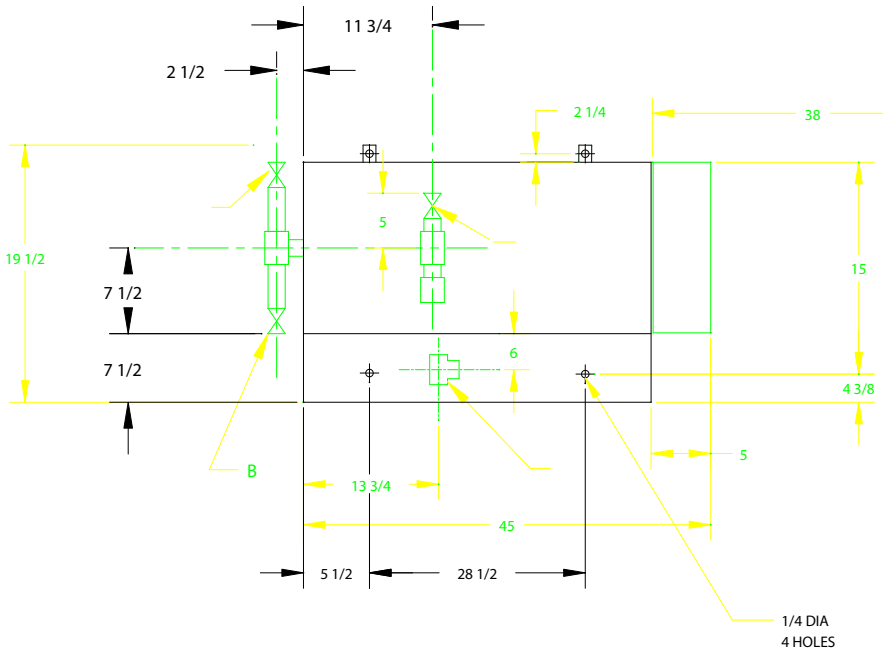

A- 1 N.P.T. MANUAL BLOW DOWN VALVE
B- 3/4 N.P.T. AUTO FLUSH & DRAIN VALVE
C- 3/8 N.P.T. WATER INLET
D- 1/2 N.P.T. STEAM OUTLET
E- 1/2 N.P.T. STEAM INLET & OUTLET OF COIL

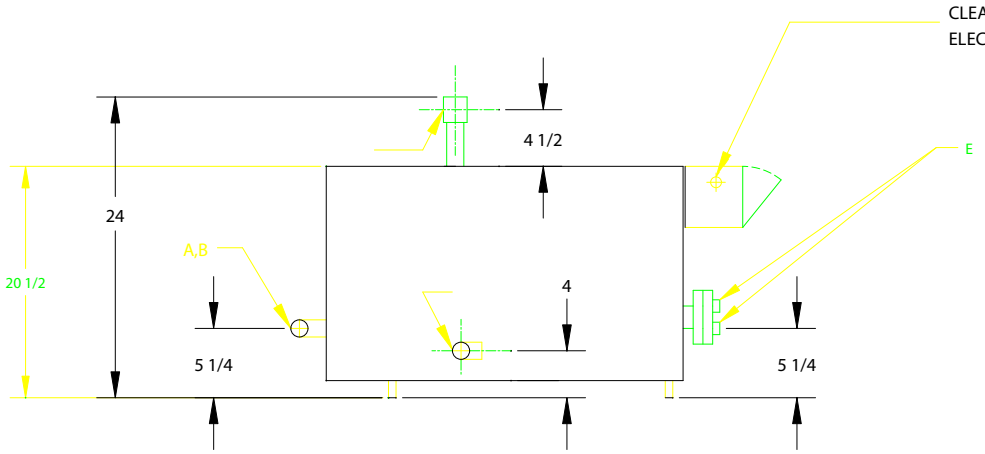

NOTES:

1. CONTRACTOR TO PROVIDE MINIMUM 8" CLEARANCE AROUND UNIT FOR SERVICE

2.WEIGHT OF UNIT: 350 LBS

REVISIONS

-DATE-	-DESCRIPTION-

DRAWN BY	JOSEPH KIM
CHECKED	
APPROVED	RALPH ASPLING
DATE	7/31/98

ELECTRO-STEAM GENERATOR CORP.
1000 Bernard Street, Alexandria, Virginia 22314-1299

DRAWING TITLE
INSTALLATION DATA
LB-20,25,30 INDIRECT STEAM

SIZE	AUTOCAD R14 FILE	DWG. NO.	REV.
	50040B	PRI-6503	-

SCALE: N/A

SHEET: 1 OF 1